LT.	BY	DATE	REVISION
A	RW	01/19/12	ADDED METRIC UNITS
B	ST	02/22/12	REVISED PRESSURES

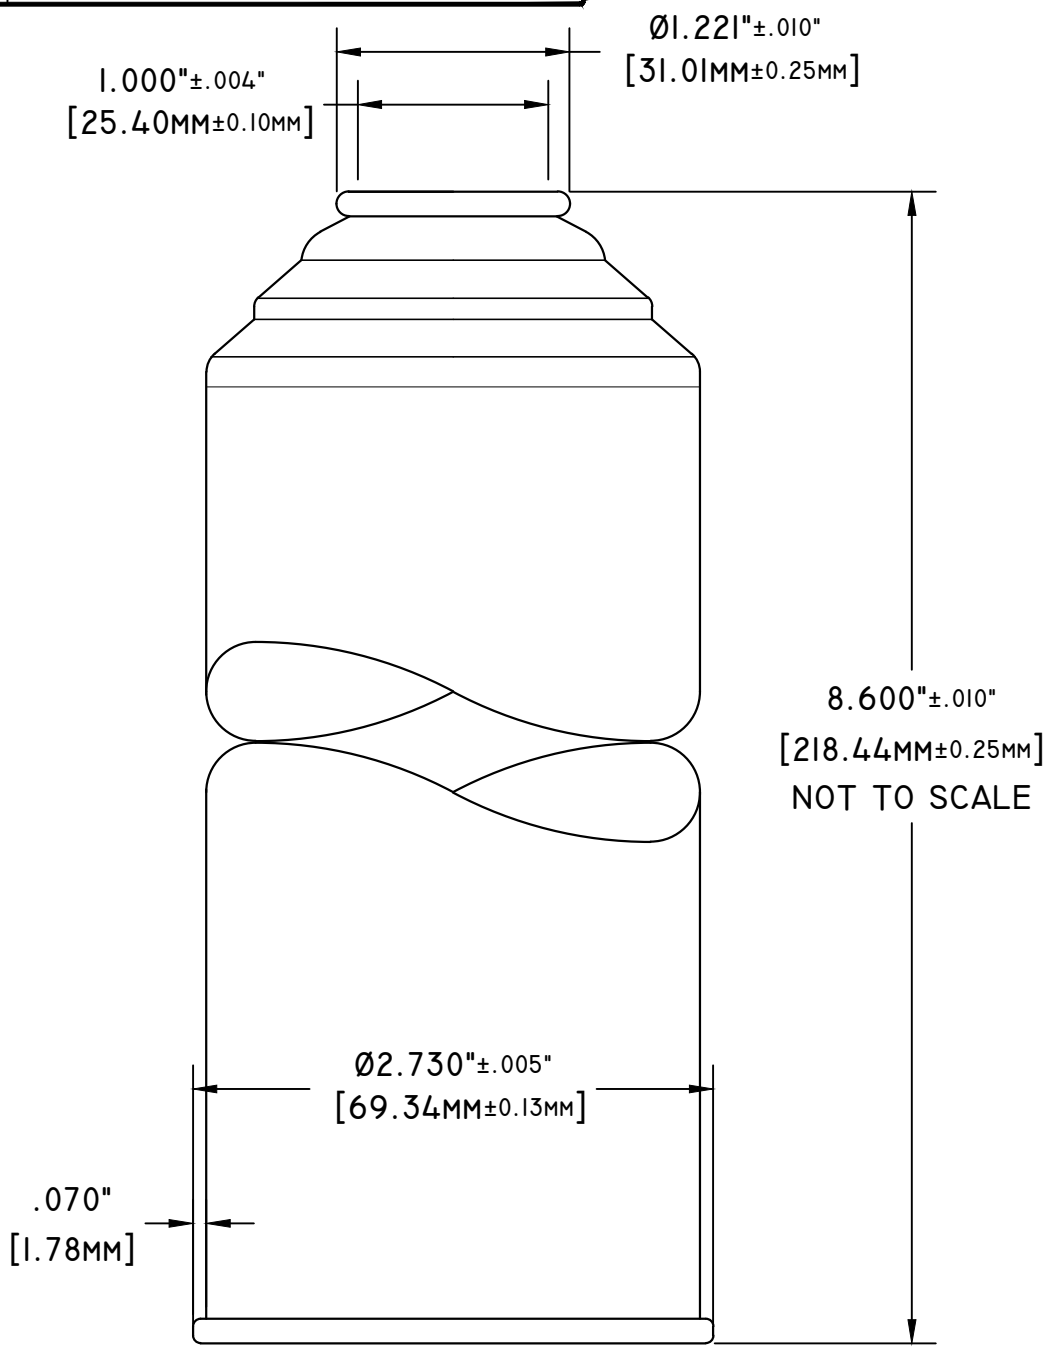

NOTES:
1. CONTAINER COMPLIES WITH SPECIAL PERMIT SP10232
2. VENT PRESSURE: 380 PSI [26 BAR] MINIMUM
3. BURST PRESSURE WITHOUT VENT: 480 PSI [33 BAR] MINIMUM
4. CAPACITY: 40.58 CU IN [665 ML]

DRAWN BY: S.T.	ITW SEXTON 3101 Sexton Road Decatur, AL. 35603-1453 Phone: (256)355-5850 Fax: (256)351-8730			The green logo indicates a controlled document. If the logo appears black, this page is considered to be used for training or reference only.
CHECKED BY:				
APPROVED BY:				
TOLERANCES (EXCEPT AS NOTED)				
DECIMAL XXX .005	TITLE: 211 x 713 STEP WITH HV400 BOTTOM. (A83)			
DECIMAL XX .01	LINE#: NA	DATE: 8/17/10	DRAWING NUMBER : 998D0083	B
ANGLE .25°	SCALE: 1 : 1	MATERIAL: NA		